


Neenah frost-proof frame and Type B cover or equal, lettered "WATER" with 2 concealed pick holes Type F. Casting shall be sized large enough to remove meter assembly without disassembling.

**PLAN**

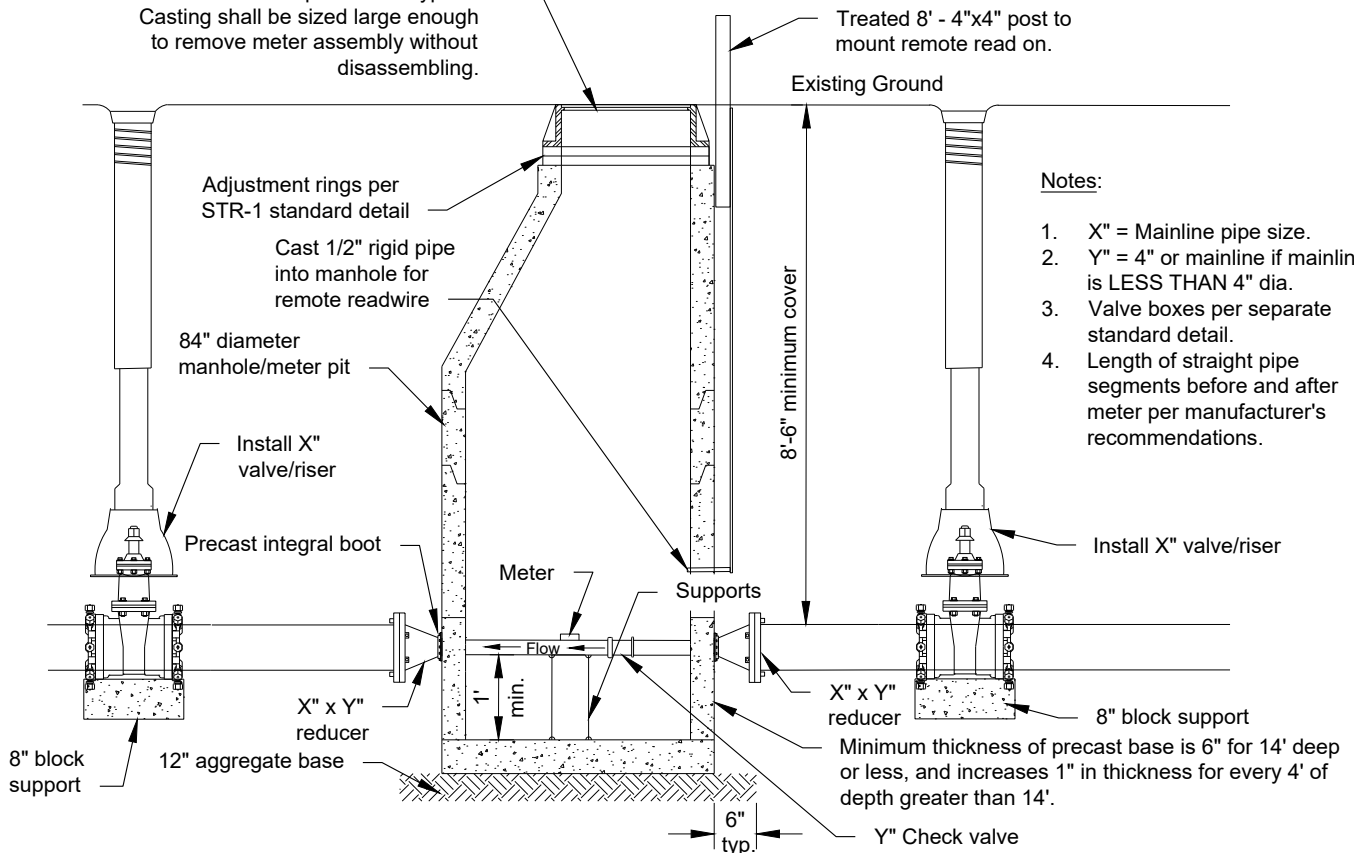

**Notes:**

1. X" = Mainline pipe size.
2. Y" = 4" or mainline if mainline is LESS THAN 4" dia.
3. Valve boxes per separate standard detail.
4. Length of straight pipe segments before and after meter per manufacturer's recommendations.

**SECTION A-A**

M:\STANDARD SPECS & DETAILS\2019\Detail Plates\WAT-6A METER PIT UP TO 4IN.dwg

City Plate No.:  
WAT-6A  
Last Revision:  
4/11/2019  
File:  
WAT\_6A.dwg

**STANDARD DETAILS  
METER PIT  
UP TO 4"**

