
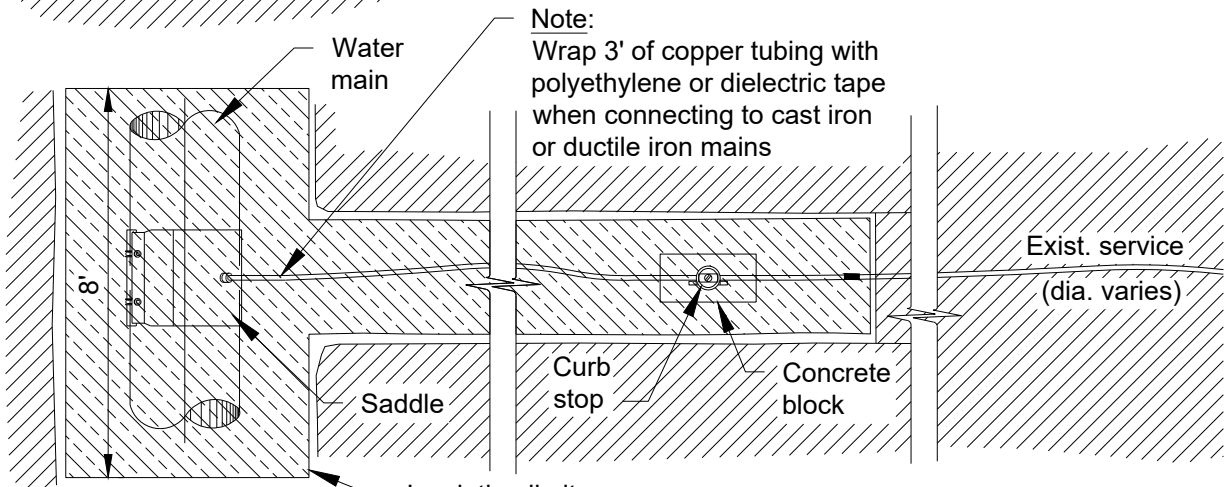


M:\STANDARD SPECS & DETAILS\2019\Detail Plates\WAT-9_WATER SERVICE FOR REPLACEMENT PROJECTS.dwg

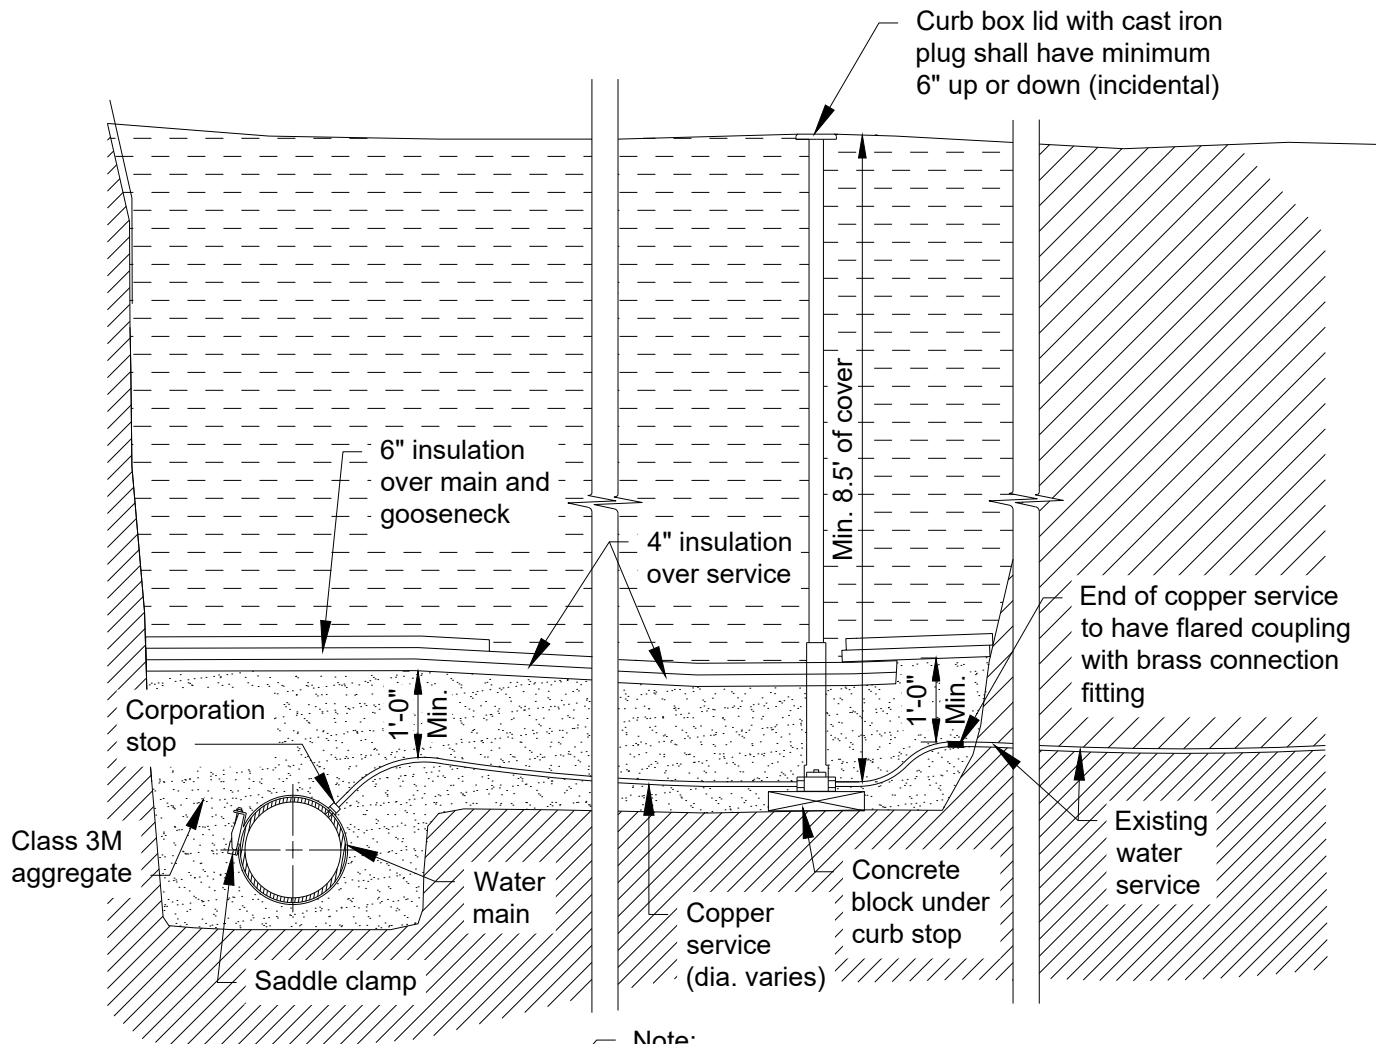

Notes:

1. Curb stop to be placed on a concrete block.
2. All insulation boards shall be 2" thick, stacked to achieve total thickness desired.
3. When stacking insulation boards, stagger each layer such that all butt joints are overlapped by the layer above.

City Plate No.: WAT-9
Last Revision: 4/11/2019
File: WAT_9.dwg

**STANDARD DETAILS
WATER SERVICE FOR
REPLACEMENT PROJECTS**

