


MA-STANDARD SPECS & DETAILS/2019/Detail Prints/P-04 LIFT STATION CONTROL PANEL - ISOMETRIC.dwg

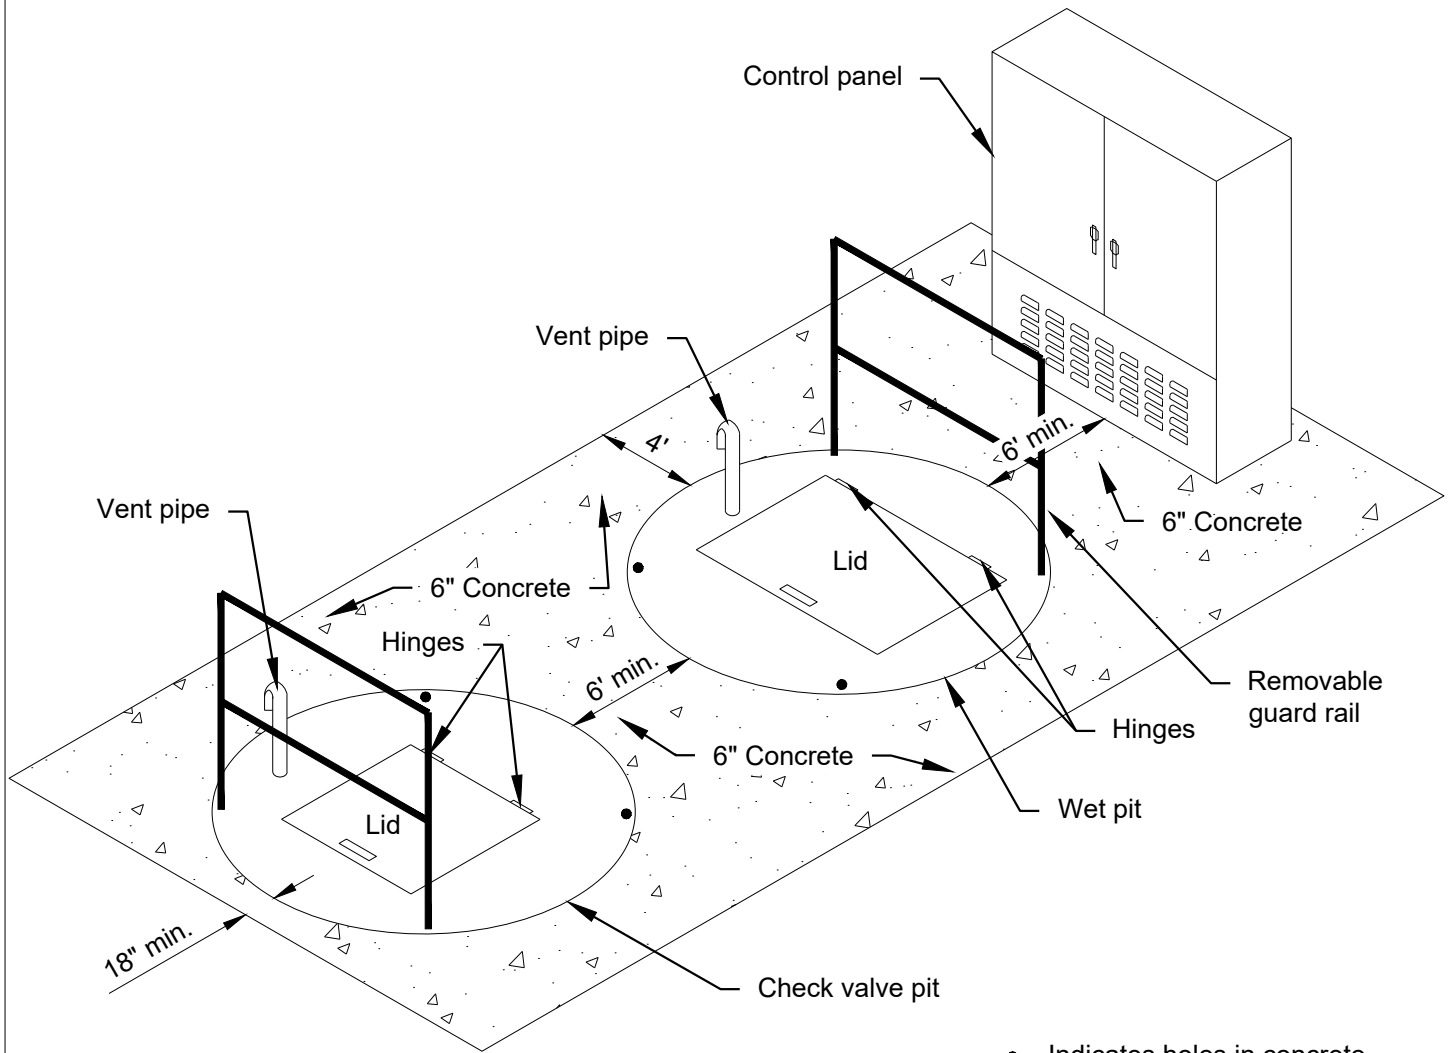

• - Indicates holes in concrete cover for guard rail retention.

**Notes:**

1. Install removable guard rails capable of being utilized on all four sides of the well. Cast sleeves into covers accordingly.
2. Access lid shall hinge toward the guard rail on wet pit setting as shown.
3. Guard rail shall be 2-inch diameter galvanized pipe.
4. All concrete shall be poured flush with the top elevation of the wet well / dry well covers.

City Plate No.:  
P-04

Last Revision:  
5/16/2019

File:  
P-04.dwg

**STANDARD DETAILS  
LIFT STATION**

