


Remove concrete for driveway construction where required. Saw cut to full depth prior to removal.

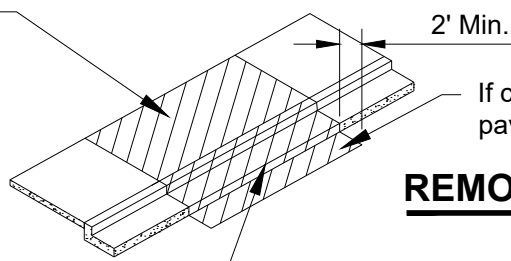


**REMOVALS**

Remove curb and gutter. Entire curb and gutter section shall be removed prior to driveway construction.

Expansion joint w/ 1/2" x 18" smooth dowels @ 24" O.C.

Sidewalk/path

Property corner shall be identified

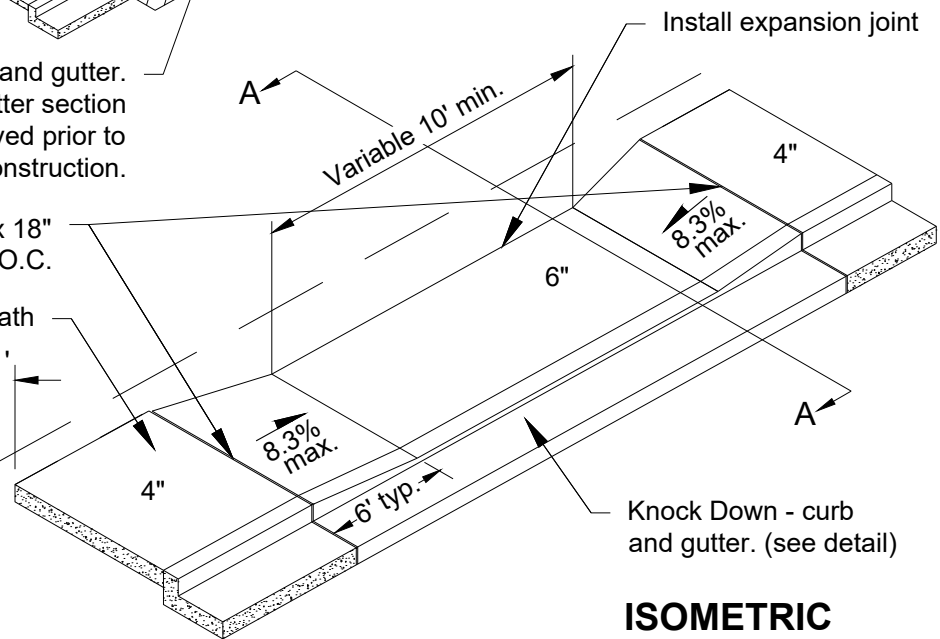


**ISOMETRIC**

**Notes:**

1. Where connecting to existing concrete, install expansion joint w/ min. two 1/2" x 18" smooth dowels @ 24" O.C.
2. Driveways greater than 10' wide shall have contraction joints perpendicular to curb with maximum 10' spacing. Match curb joints.
3. Forms are required on all edges.
4. All HMA patches shall be NDDOT FAA 43 HMA Pavement, PG 58S-28.
5. Max. cross-slope of sidewalk/path shall be 2% at all locations.

Contraction joint if poured monolithic or 1/2" x 18" epoxy coated deformed bar @ 24" O.C. if poured separate

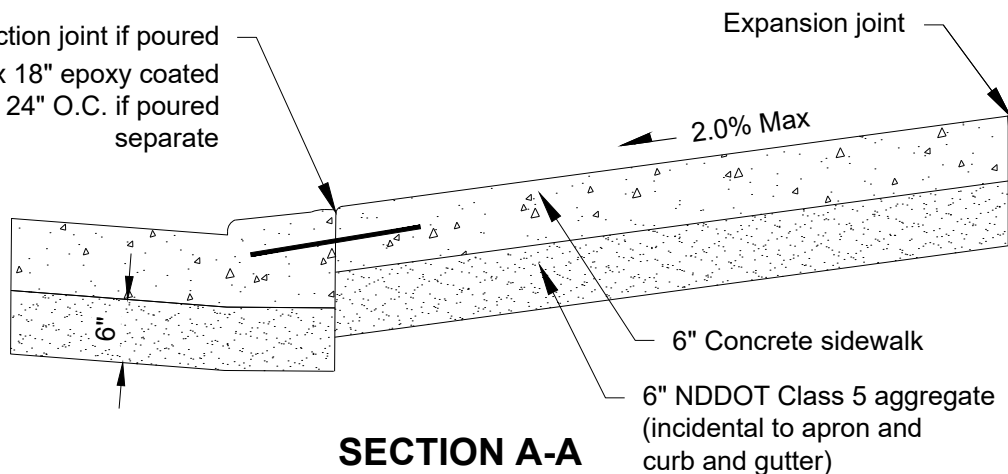

**SECTION A-A**

Right of way line, sidewalk or exist.driveway

City Plate No.:  
STR-11A  
Last Revision:  
12/18/2020  
File:  
3300

**STANDARD DETAILS  
CONCRETE DRIVEWAY APRON  
BOULEVARD 0 to 1.5 FT**

