


MASTANDARD SPECS & DETAILS/2022/10Detail/BED-7 ENCASEMENT INSULATION.dwg

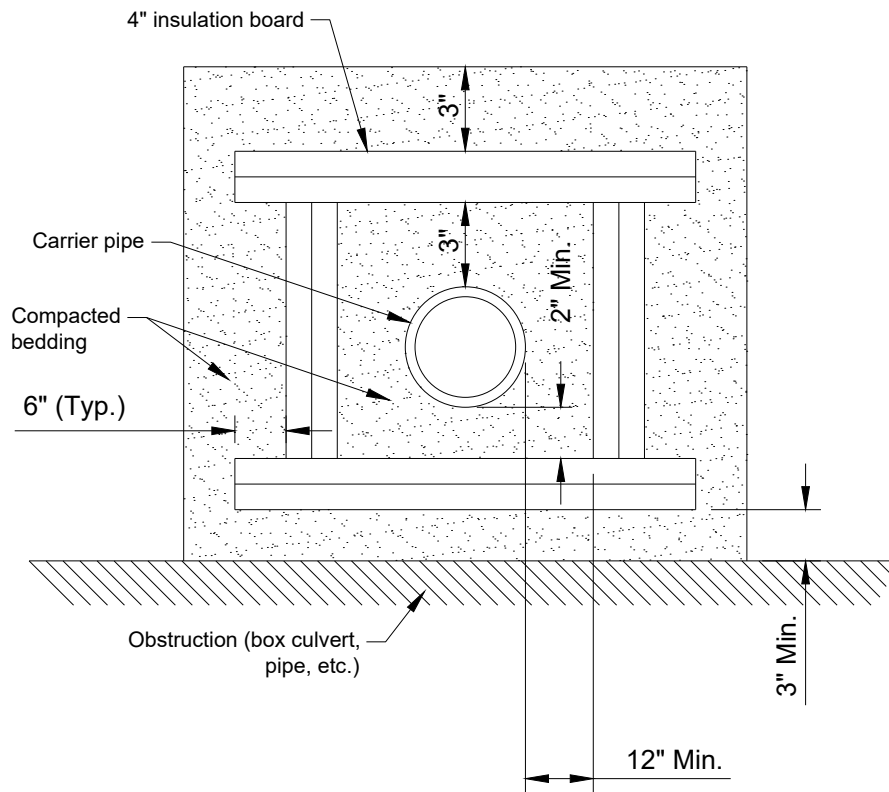

**NOTES:**

1. Encasement must be 8 LF min. along the carrier pipe.
2. When stacking insulation boards, stagger each layer such that all butt joints are overlapped by the layer above (18" min.)

City Plate No.: BED-7
Last Revision: 12/18/2020
Section: 2100, 2200, 2300, 2400

**STANDARD DETAILS  
ENCASEMENT INSULATION**

