



Notes:


1. Detectable warning panels shall be installed to match the ramp width (the usable portion of ramp).
2. Curb ramps shall be constructed in accordance with NDDOT Standard Drawing D-750-03.
3. Refer to NDDOT Standard Drawing D-750-03 for additional curb ramp types.
4. Desirable turning space is 5' by 5' or larger with a minimum size of 4' by 4'. Maximum slope for turning spaces is 2% in any direction.
5. Concrete for ADA ramp shall be installed 6" thick.

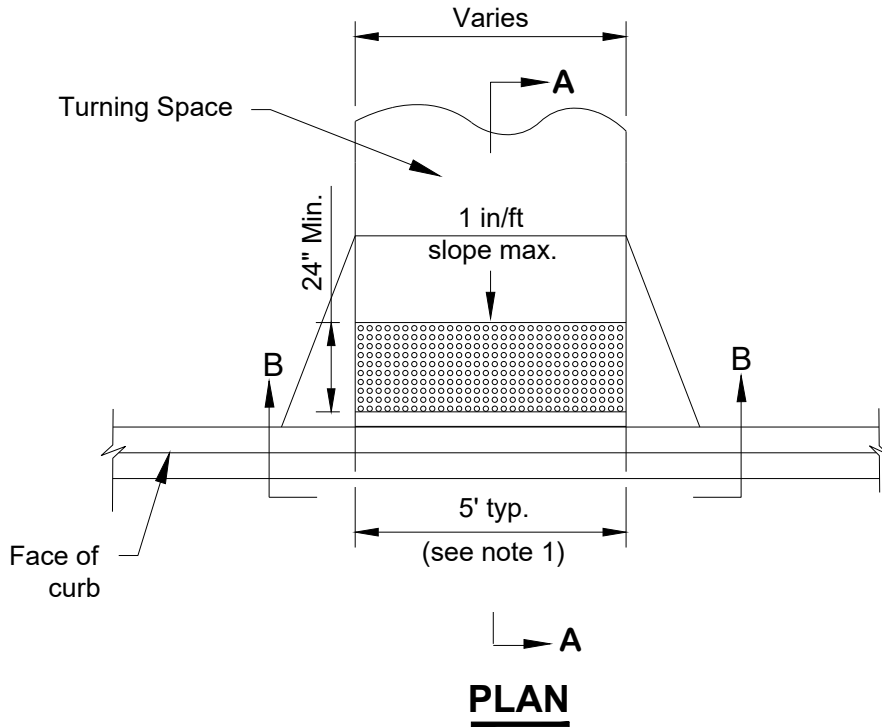

PLAN

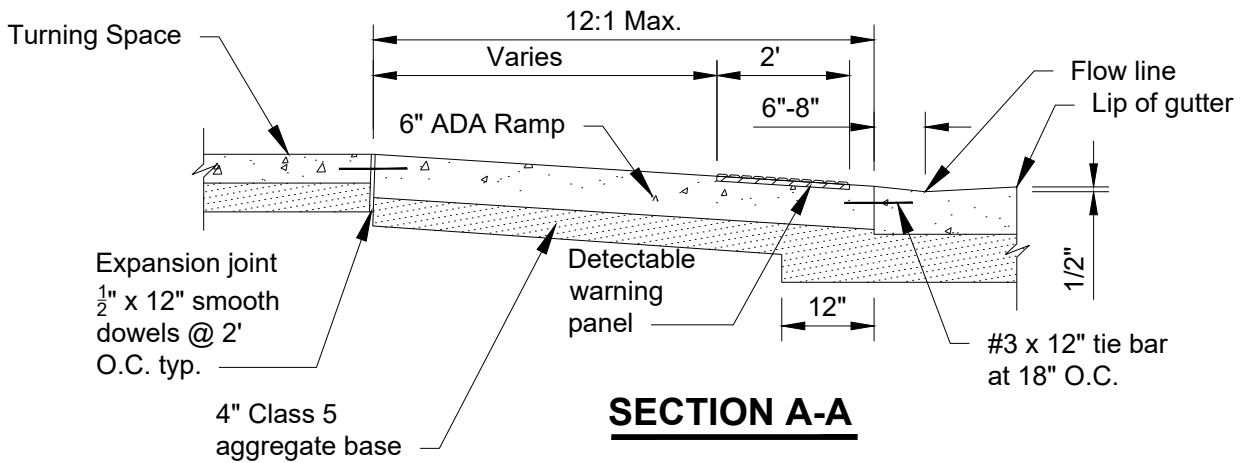

SECTION A-A

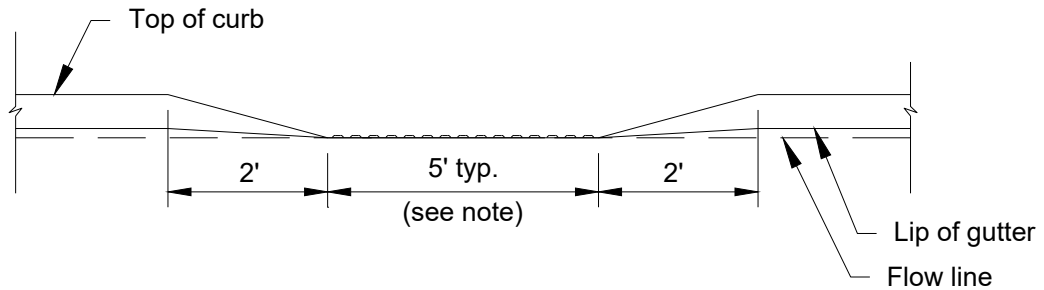

SECTION B-B

M:\STANDARD SPECS & DETAILS\2021\Detail\STR-8 PEDESTRIAN CURB RAMP PATHWAY-SIDEWALK.dwg

City Plate No.: STR-8
Last Revision: 12/18/2020
Section: 3300

**STANDARD DETAILS
PEDESTRIAN CURB RAMP
PATHWAY / SIDEWALK**

